

RECOMMENDED USE RATE FOR MELAKLEAN PRODUCTS


The following are guidelines only, generated from field tests corroborated by microbial results. Melaklean advises the technician to use system and site knowledge to also adjust dosage for maximum occupant comfort.

Individual Blister packs

Pack size	Air volume/velocity	Floor Area in mt ² **	Kw rating	Life expectancy	Number used recommendation
15 ml	Up to 400 lt/sec	40-50	6.5	10-12 weeks	1 to 2
50 ml	400+ to 1200 lt/ sec	50-140	20	8-12 weeks	1
50 ml	1200+ to 4000 lt/ sec	140-350	20 to < 50	6-8 weeks	1 to 2
50 ml	4000+ to 10000 lt/ sec	350-680	50 to 100	4-6 weeks	1 to 3
500 ml disperser unit	10000 lt/ sec air handling unit (small)	680 +	> 100	4 weeks	15 min on every 2 hours

** approximate guidelines only

DOSAGE RATE GRAPH WHEN USING DISPERSER UNIT IN AIR HANDLING ROOM.

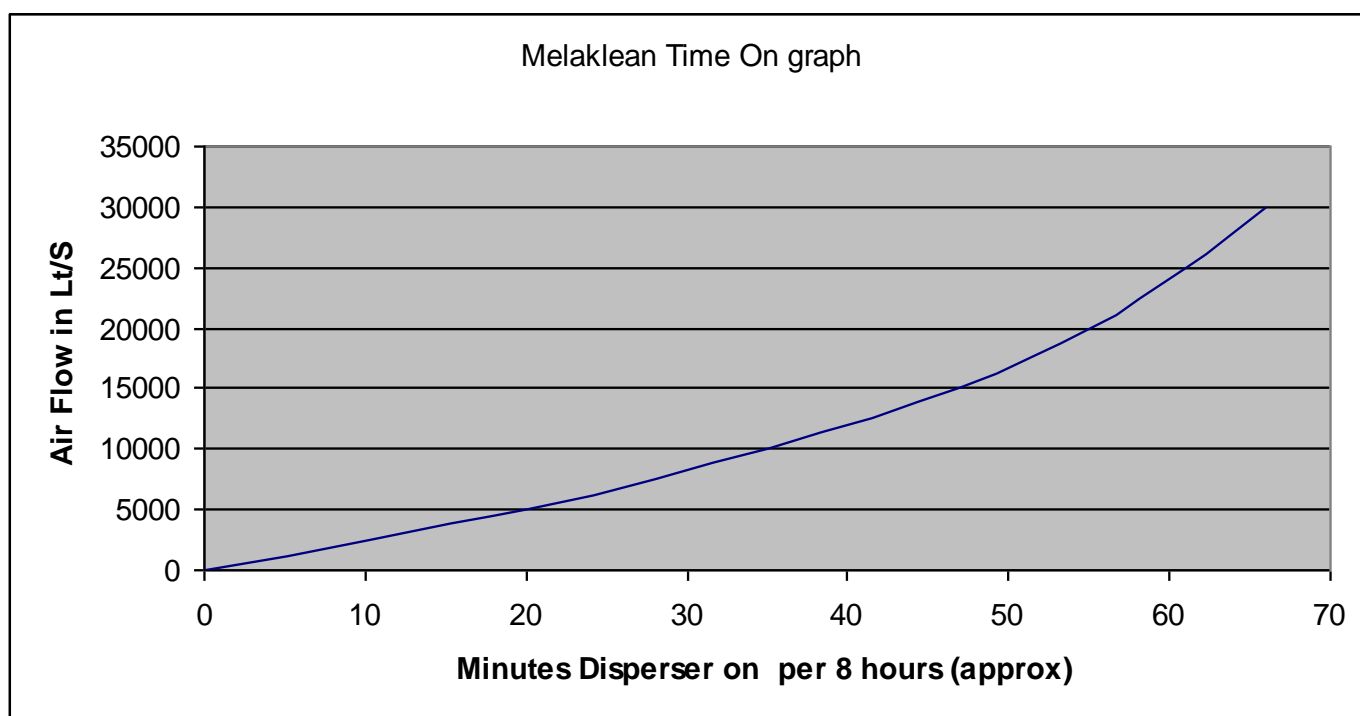

HOW TO READ GRAPH : at 10000 litres/second, the disperser needs to be on for approx 35 minutes per 8 hour day. There fore set the on/off timer for the unit at 35min/ 480 min = 7 min per hour or 15 min on every two hours the air handling room is working.